

Diamond A Mutual Water Company

Annual Meeting

March 25, 2018

50,000 Gallon Redwood Storage Tank



Dismantling Redwood Storage Tank



Excavation for enlarged tank foundation



Foundation prepared for new steel tank




Floor and first ring of steel panels installed



Second ring of panels and roof installed
90,000 Gal. Tank completed



Zone 3A Tank Roof (Viewcrest)

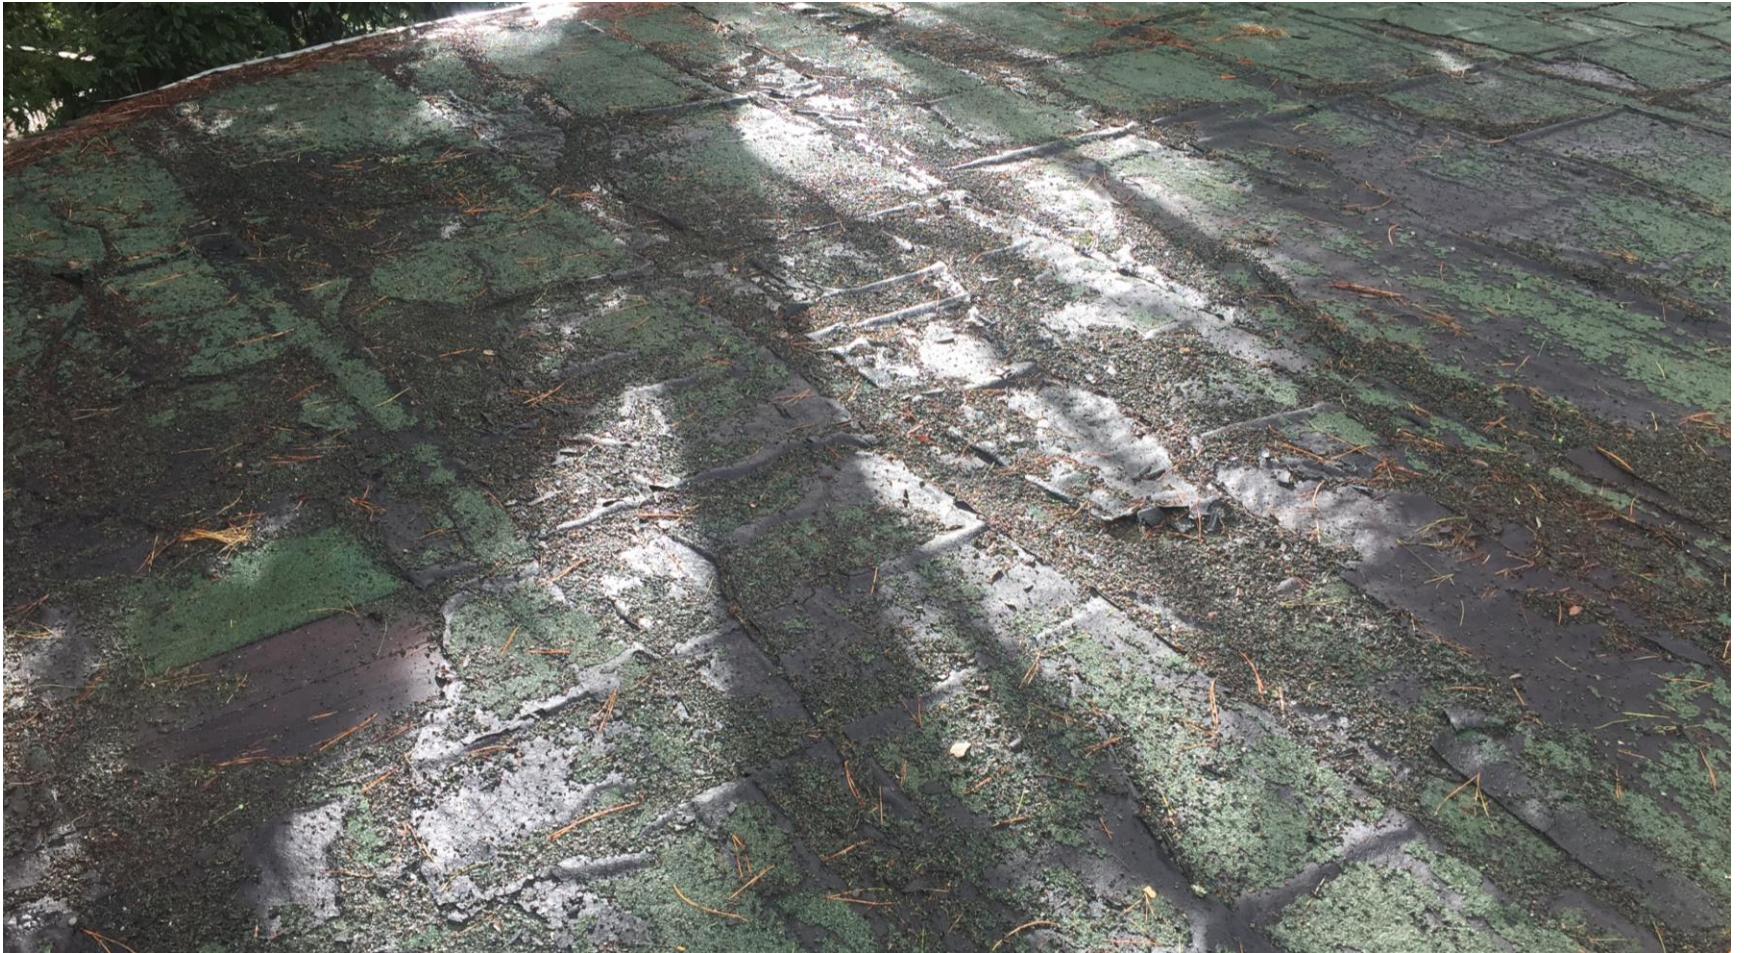

Plywood overlay



White roofing membrane installation

